


User's Manual



**Please Do Not Return the Product to the Store.
Contact us with any questions.**

Installation Manual

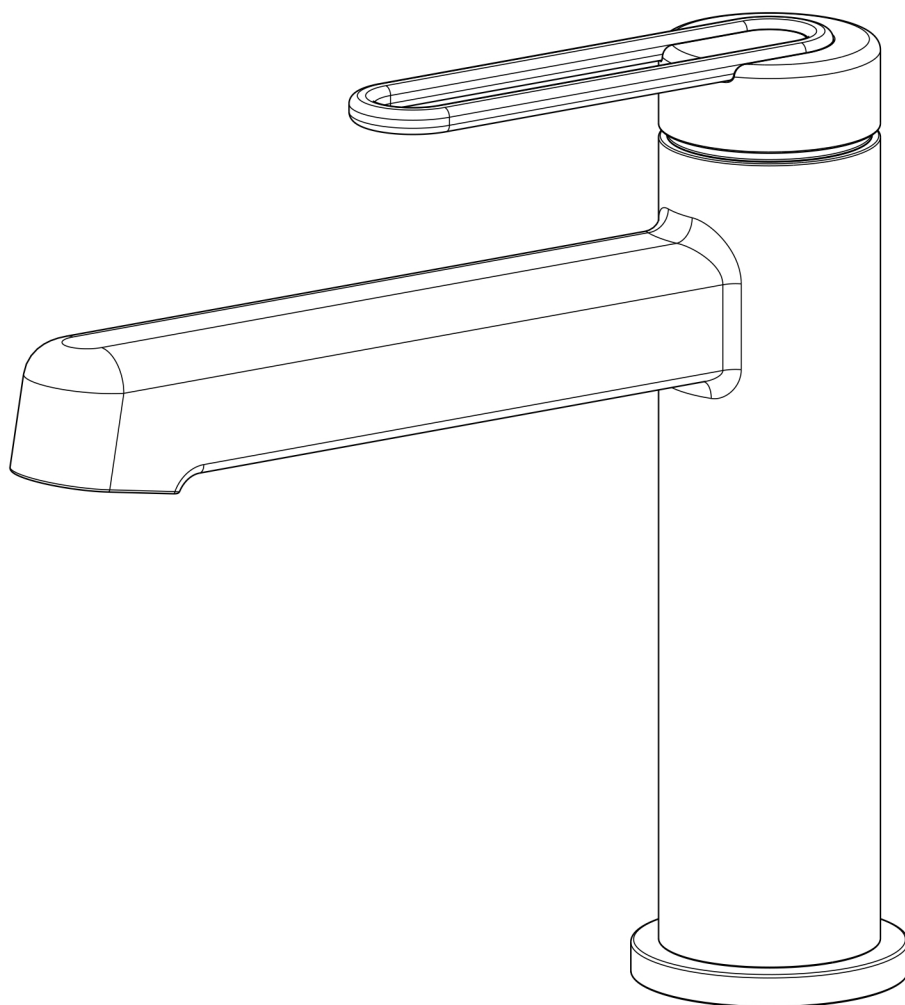

#

5001 East iPademo Street, Ontario, California 91761-2166 • (909) 472-4100 Fax (909) 472-4401 • www.lapmo.com

##

LAPMO Research and Testing, Inc. is a product certification body which tests and inspects sample items from the supplier's stock to test the material or a workmanship or design to a specification. The results of the testing are reported to the customer. This is not a certification of the supplier's factory and workmanship as well as the measurement of the supplier's Quality Assurance System. This listing is subject to the conditions on which the LAPMO facility issues such as it is a certified as any requirements, insurances or guarantee by LAPMO Research and Testing, Inc. or the product acceptance by Authorities having jurisdiction.

Effective Date: August 2013

Valid After: August 2014

Product: Plumbing Fittinging Fittings

File No: 6737

Issued To: Karping Bear Cartridge Co., Ltd.
 No. 21 Wulianan Dong Road,
 Shuiluo Town,
 Wafang City, GUANGDONG
 China

Identification: Plumbing supply fittings complying with this standard shall be marked with the manufacturer's recognized name, trademark, or other mark in the case of private labeling, the name, trademark or mark of the customer for whom the fitting was manufactured. The marking shall be accompanied by use of a permanent mark or by placing a permanent label on the product. Markings on plumbing supply fittings shall be visible after installation.

Single-handle, single-control, and automatic compensating mixing bath and shower valves may have identifiable temperature control settings in which the settings are indicated by words "Cold", "Warm", "Hot", etc.), by numbers, or graphically.

Package shall be marked with the manufacturer's name, trademark, or other mark as well as the model number or, in the case of private labeling, the name, trademark, or mark of the customer for whom the fitting was manufactured as well as the model number.

David McKinney
 Chairman, Product Certification Committee

Russ Chang
 CEO, The LAPMO Group

This listing remains current until the end of the month indicated on the Effective Date and valid after the chosen date. Any change in materials, manufacturing process, marking or design without notice, or any change of the Product Certification Committee, or any withdrawal of this listing, shall be the responsibility of the manufacturer. The manufacturer is responsible for the maintenance of the listing. Payment of a reference fee to LAPMO for advertising purposes may be made any by specific written agreement of LAPMO Research and Testing, Inc. Any alteration of this certificate would be grounds for revocation of the listing.

IAPMO RESEARCH AND TESTING, INC.

5001 East Philadelphia Street, Ontario, California 91761-2816 • (909) 472-4100 Fax (909) 472-4344 • www.iapmo.org

CERTIFICATE OF LISTING

IAPMO Research and Testing, Inc. is a product certification body which tests and inspects samples taken from the supplier's stock on the market of a wide variety of products commonly used in the plumbing and mechanical trades. The products are tested in accordance with published standards of the supplier's industry and, where available, as well as the acceptance of the supplier's Quality Assurance System. This listing is subject to the conditions set forth in the IAPMO Research and Testing, Inc. Terms and Conditions of Listing. The listing is not a warranty, nor is it a statement of approval by IAPMO Research and Testing, Inc. of the product acceptance by Authorities Having Jurisdiction.

The most updated information on this Certificate of Listing is available online at plis.iapmo.org

Effective Date: **October 26, 2016** - Rev. 11/28/2016- **Valid After: October 26, 2017**

Product: **Flexible Water Connectors** File No. **4955**

Issued To: **Yuhang Jiangling Plumbing Hose & Parts Co., Ltd.
Package Industry Zone
Yuhang County
Shewang 317600,
China**

Identification: Manufacturer's name or trademark and cUPC® certification mark. Special note on label "For use with water in exposed locations only."

Characteristics: Flexible water connectors manufactured in various sizes, lengths and metal end fittings for hot or cold water applications that consist of an inner tube, which may or may not have an outer braided cover. Connectors are to be installed for use in accessible locations only and in accordance with the manufacturer's instruction, and the latest edition of the Uniform Plumbing Code.

Products listed on this certificate have been tested by an IAPMO R&T recognized laboratory. This recognition has been granted based upon the laboratory's compliance to the applicable requirements of ISO/IEC 17025.

Products are in compliance with the following code(s):
Uniform Plumbing Code (UPC®)

David McCreary
Chairman, Product Certification Committee

Rene Chaney
CED, The IAPMO Product Council

This listing period begins on the last day of the month indicated on the Effective Date and Valid After Dates above and may change as material, manufacturing process, marking or design alterations having been attempted or reported at the Product Certification Committee, or any address of nonconformance with applicable codes and standards or of inferior construction, may demand further testing or measures of the listing. Approval of or reference to this listing for advertising purposes is hereby given by the service center personnel of IAPMO Research and Testing, Inc. Any alteration of this certificate must be given to the personnel of the issuing body. This document shall be kept separate and not destroyed.

IAPMO RESEARCH AND TESTING, INC.
5001 East Philadelphia Street, Ontario, California 91761-2816 • USA • 909-472-4100 • 909-472-4244 • www.iapmo.org

CERTIFICATE OF LISTING

IAPMO Research and Testing, Inc. is a product certification body which tests and inspects samples taken from the supplier's stock or from the master of a continuous run of pipe, every component and assembly. This activity is required only under certain circumstances of the supplier's history and experience as well as the assessment of the supplier's Quality Assurance System. This listing is subject to the conditions and terms in the Characteristics Entry and is not to be interpreted as any endorsement, acceptance or approval by IAPMO Research and Testing, Inc. or the product acceptance by Authority Having Jurisdiction.

The most updated information on this Certificate of Listing is available online at plis.iapmo.org

Effective Date: November 2016

-Rev. 3/1/2017-

Valid Through November 2017

Product:

Flumbing Fixture Fittings

File No. 4528

Issued To:

Nepgerl Inc.
371 Hattawack Heights
Hattawack, NJ 08750

Identification: Each fitting component shall bear permanent legible markings to identify the manufacturer. This marking shall be the trade name, trademark, or other mark known to identify the manufacturer. The product shall also bear all other markings required by the standard. The marking shall be located where it can be readily seen after installation is complete. The product or packaging shall also bear the UPC® certification mark.

Characteristics: Flumbing fixture fitting components to be installed in accordance with the manufacturer's instructions and the requirements of the latest edition of the Uniform Plumbing Code.

Products listed on this certificate have been tested by an IAPMO RPT recognized laboratory. This recognition has been granted based upon the laboratory's compliance to the applicable requirements of ISO/IEC 17025.

Products are in compliance with the following code(s):
Uniform Plumbing Code (UPC®)
National Plumbing Code of Canada





Tom Collins
Chairman, Product Certification Committee

Ron Chany
CEO, The IAPMO Group


This listing is based upon test results of one or more installed in the Effective Date and After Date shown above. Any change in material, manufacturing process, including a design without having had submitted the approval of the Product Certification Committee, or any evidence of non-compliance with applicable code and standards or of other nonconformity may be deemed sufficient cause for revocation of this listing. Revocation or extension to the next year for scheduling purposes may be requested only upon written permission of IAPMO Research and Testing, Inc. Any application of this certificate must be capable of verification of the listing. This document shall not be reproduced or its content

Installation precautions


- a) After opening the product package, please check the completeness of the parts listed in the "Standard Parts List". If there are any defects, please contact your local dealer immediately.
- b) The main part of the faucet has been tested and debugged by the factory. Do not disassemble it by yourself to avoid affecting the performance.
- c) Red and blue plastic wrenches were added to the supply hoses; make sure that the blue one is connected to the right supply valve and the red one to the left valve.
- d) Before installing the faucet, make sure to remove any impurities or sludge in the buried pipeline so as not to block or affect the water output function.
- e) The internal structure of the faucet contains components that are susceptible to high temperatures such as silica gel. Do not install it in high temperature environments or use it at a water temperature exceeding 90°C for a long time.
- f) The faucet functions at a minimum water pressure of 0.5 bar to 7.5 bar maximum.
- g) Do not bend the hose excessively. Make sure that it is not deformed after installation.




Instalation precautions

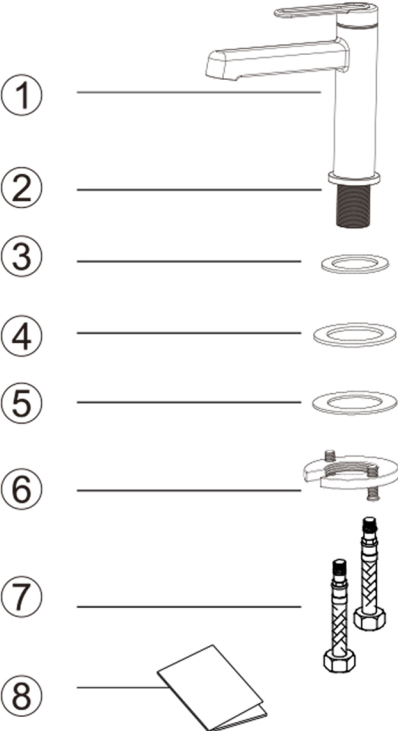	No	Part name	Quantity
	1	Main Body	1
	2	Decorative base	1
	3	Silicone gasket	1
	4	Silicone gasket	1
	5	Stainless steel gasket	1
	6	Retaining nut	1
	7	Inlet hose	2
	8	Instruction manual	1


INSTALLATION STEPS

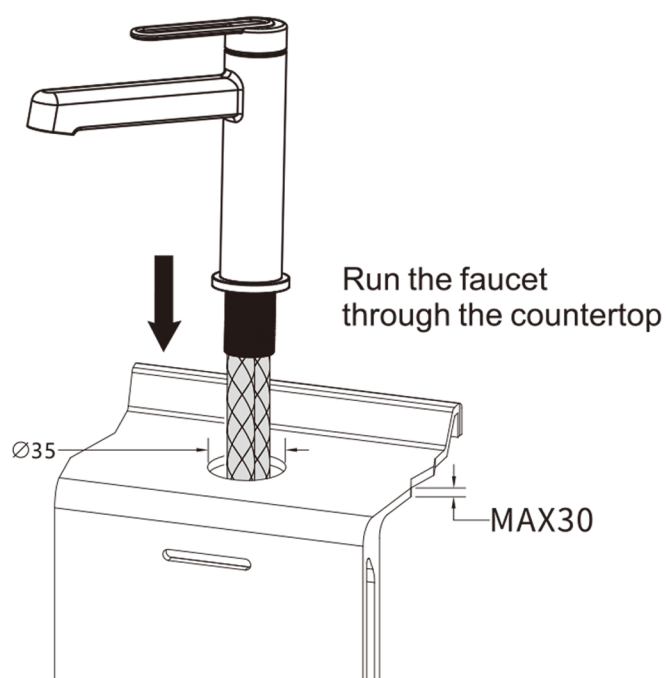


The recommended opening size of mesa is 35-40mm and the maximum thickness is 30mm

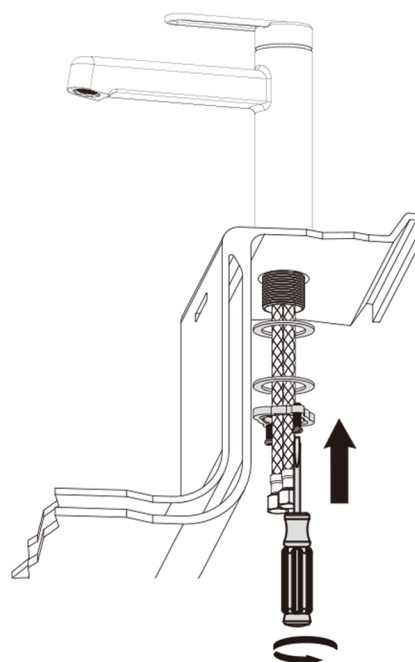

Tighten the nut and fasten the screw with a screwdriver

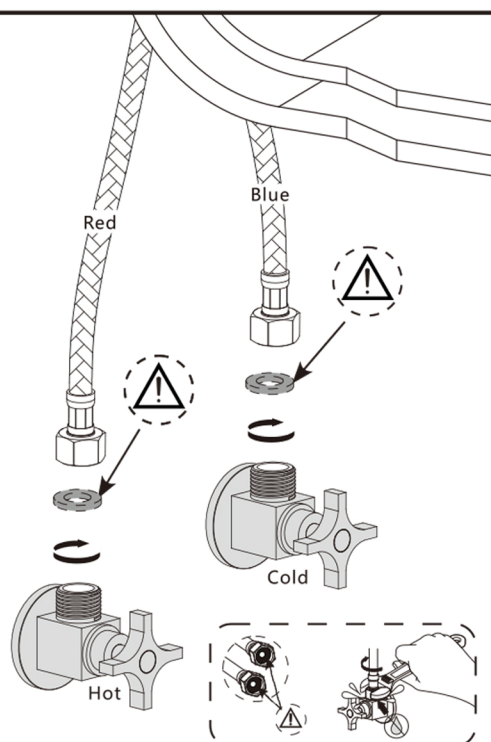


Check whether the gasket is connected to the water inlet pipe by securing it with a wrench


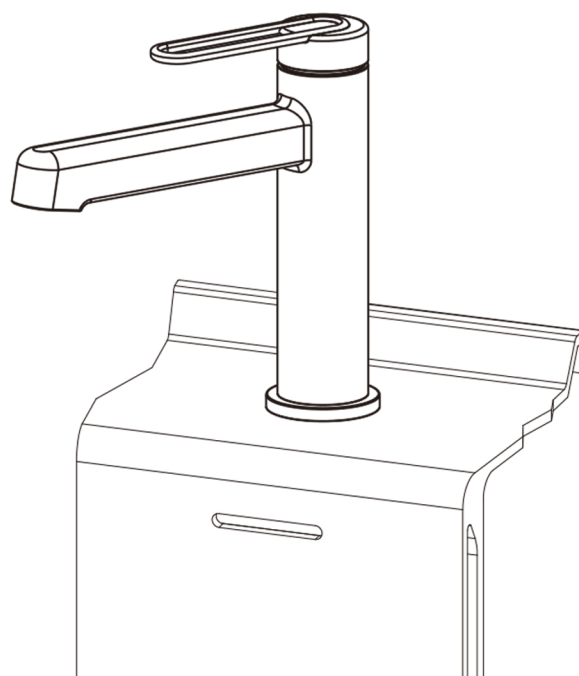


Installation complete

Product size

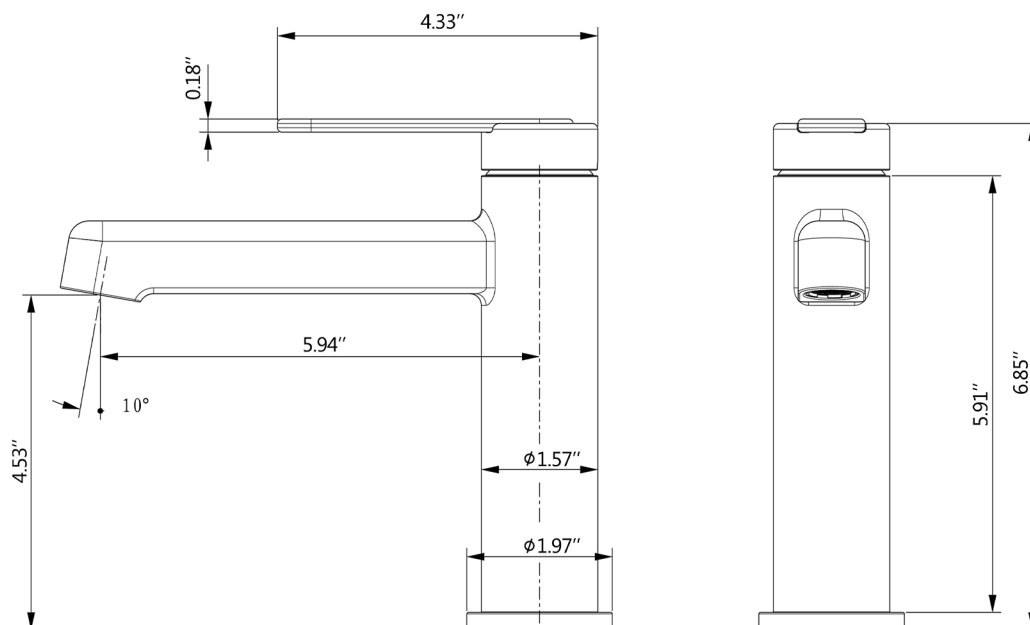

Usage method

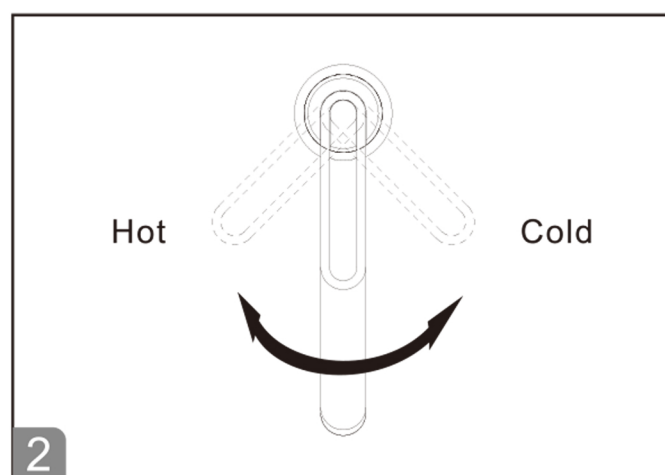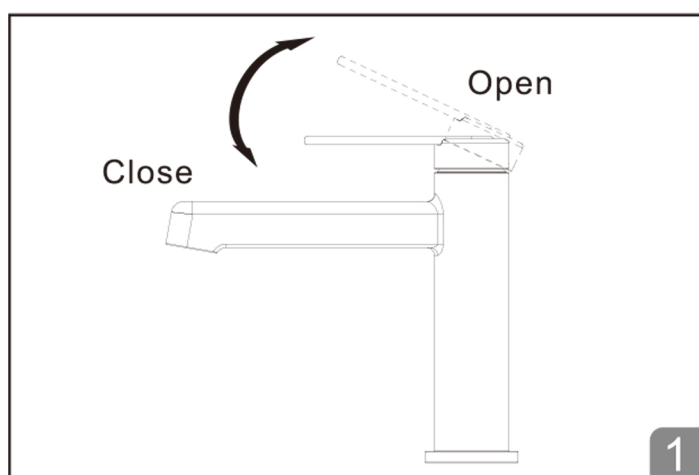

Care and maintenance

1. Wash the surface of the faucet frequently with water, and then dry it with a cotton cloth
2. It is strictly prohibited to use acid cleaning agent to corrode the faucet surface and affect the service life
3. It is strictly forbidden to disassemble each part of the faucet by itself, which can easily cause the risk of water seepage
4. If the tap water output becomes smaller, check whether the inlet pipe and bubbler are blocked by scale and clean up



**Please Do Not Return the Product to the Store.
Contact us with any questions.**